


FACE VIEW



PLAN VIEW

1. RETAINING WALL AND EXISTING STRUCTURE MUST REMAIN STRUCTURALLY INDEPENDENT.
2. CONTRACTOR TO ENSURE FOUNDATION WALL IS CAPABLE OF SUPPORTING ADDITIONAL SURCHARGE OF ABUTTING RETAINING WALL AND SOIL.
3. BATTER OF WALL MUST BE CONSIDERED. ENSURE THAT THE END OF THE RETAINING WALL IS NOT EXPOSED.

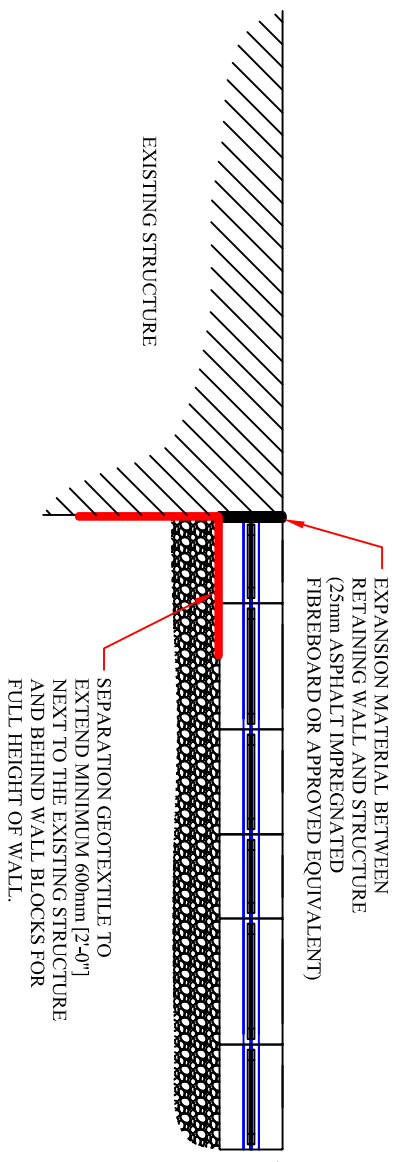

This graphic represents a preliminary, non site-specific design. If used for construction, a registered professional engineer must be retained to review & approve the design, confirm site conditions, and inspect construction.

Nueva 75 Wall System
Wall Abutting Structure